


G:\LANL Engineering Standards\Eng Manual [LEW]\2. Approved\ST-D2020-1\111.dwg, 09/18/03 @ 14:17 03598

H
G
F
E
D
C
B
A



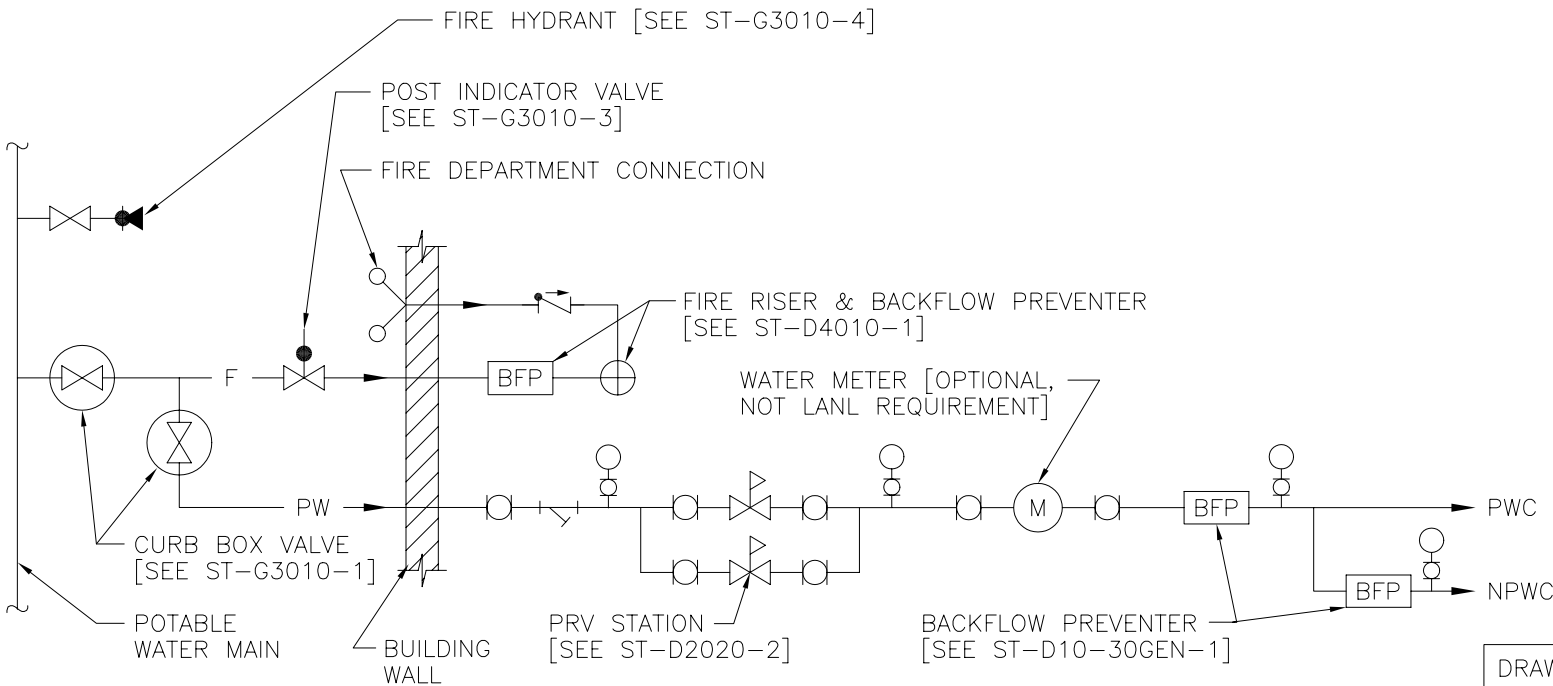

DRAWING DEVELOPED FOR ML-3/
ML-4 PROJECTS. FOR ML-1/
ML-2, ADDITIONAL REQUIREMENTS
AND QA REVIEWS ARE REQUIRED.
(REMOVE THIS NOTE WHEN IN-
SERTED INTO A DRAWING PACK-
AGE).

SITE/BUILDING WATER COMPONENT DIAGRAM

SCALE: NONE

NOTES FOR DESIGNER: (DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)

1. WHEN EDITING DETAIL TO SUIT PROJECT, ADD JOB SPECIFIC REQUIREMENTS AND DELETE ONLY THOSE PORTIONS THAT DO NOT APPLY. TO SEEK A VARIANCE FROM APPLICABLE REQUIREMENTS, CONTACT THE ESM MECHANICAL POC.
2. REFER TO THE FOLLOWING LANL STANDARDS FOR ADDITIONAL REQUIREMENTS:
A. ENGINEERING MANUAL, FIRE PROTECTION, CIVIL, AND MECHANICAL CHAPTERS.

1	8-14-03	U	EDITORIAL CHANGES AND DWG NO. WAS STR005.	RP	AY	RR	GG	TO
NO	DATE	CLASS REV	DESCRIPTION	DWN	DSGN	CHKD	SUB	APP
<div> FACILITY & WASTE OPERATIONS DESIGN ENGINEERING CONSTRUCTION SERVICES</div>								
ENGINEERING STANDARDS MANUAL				DRAWN: R. PEARSON				
SITE/BUILDING WATER COMPONENT DIAGRAM				DESIGN: A. YAEGER				
				CHECKED: G. GREWAL				
				DATE: 9-5-02				
BLDG X				TA-X				
SUBMITTED				APPROVED FOR RELEASE				
DISCIPLINE: POC: GURINDER GREWAL				STANDARDS MANAGER: TOBIN ORUCH				
<div> Los Alamos NATIONAL LABORATORY</div>				SHEET 1				
CLASSIFICATION: U				REVIEWER: LARRY BAYS				
PROJECT ID				DRAWING NO				
CHAPTER 6				ST-D2020-1				
				REV 1				